

## DESCRIPTION

The Magnetrol<sup>®</sup> Kotron<sup>®</sup> Model 82 RF Capacitance transmitter is one of the most cost effective level transmitters available today. Compact in size, it employs state-ofthe-art surface mount technology in an encapsulated (potted) module for a stable, accurate measurement in a wide range of materials.

# FEATURES

- 4–20 mA isolated output signal (reversed 20–4 mA output optional)
- Utilizes a 24 VDC current loop for power source and signal transmission
- Minimum span 50 pF
- Maximum span 4000 pF
- Integral metering points to allow the local measurement of 4–20 mA loop current without breaking the two-wire circuit loop
- Power indicator LED varies in brightness with level changes
- ±0.25% repeatability
- FM and CSA listed intrinsically safe when used in conjunction with an approved barrier
- Available with a full range of rigid and flexible sensing probes to 5000 psig (345 bar) and +1000 °F (+538 °C)

# APPLICATIONS

- Continuous level monitoring
- · Liquid-liquid interface level measurement
- Clean or dirty liquids
- Viscous liquids
- Light slurries
- High temperature liquids
- Hydrocarbons & solvents
- Acids & corrosive liquids
- Food & beverage

# Kotron<sup>®</sup> Model 82 CE RF Level Transmitter



# TECHNOLOGY

The amount of capacitance developed in any vessel is determined by the size (surface area) of the probe, the distance from the probe to its ground reference (e.g. tank wall), and the dielectric of the medium being measured.

If the probe's mounting position is fixed and the dielectric value of the medium is constant, then the amount of capacitance developed becomes dependent on the media in contact with the probe.


As media rises and falls in the tank, the amount of capacitance developed between the sensing probe and the ground also rises and falls. This change in capacitance is converted into a proportional 4–20 mA output signal.

# ELECTRICAL SPECIFICATIONS


Supply Voltage	24 VDC, (14–40 VDC)	
Current	38 mA maximum	
Line Variation	Less than ±.10%/volt, for voltages between 16–40 VDC	Loop Resistance vs. Power Supply Voltage 1300 1200 ohms 1200 @ 40V
Ambient Temperature	-40 to +160 °F (-40 to +70 °C) $\odot$	<u>د</u> 1100
Zero Range	1000 pF (max.), 0 pF (min.)	Q @ 1000 U g 900
Span Range	4000 pF (max.), 50 pF (min.)	900 900 900 900 900 900 900 900 900 900
Output Linearity	50–500 pF ±1% of span	
	501–1500 pF ±2% of span	0 m 500 2 m 400 400 ohms at 24V
	1501–4000 pF ±1% of span	0 50 500 400 ohms at 24V Winger 300 Winger 200 Winger 100
Response Time	Less than 0.1 second	¥ 100
Repeatability	±0.25%	0 12 14 16 18 20 22 24 26 28 30 32 34 36 38 40
Temperature Coefficient of Output	4000 pF span: Less than 0.035%/°F (0.063%/°C)	Power Supply Voltage (Volts) Electrical data
-40 to +160 °F (-40 to +70 °C)	1000 pF span: Less than 0.025%/°F (0.045%/°C)	
	50 pF span: Less than 0.075%/°F (0.135%/°C)	

① Consult factory for higher temperatures on remote mounted transmitter

# DIMENSIONAL SPECIFICATIONS INCHES (mm)

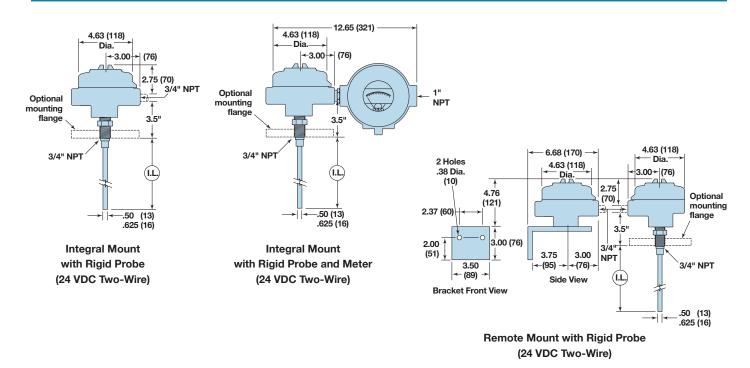

#### DIMENSIONAL SPECIFICATIONS INCHES (mm) (cont.)

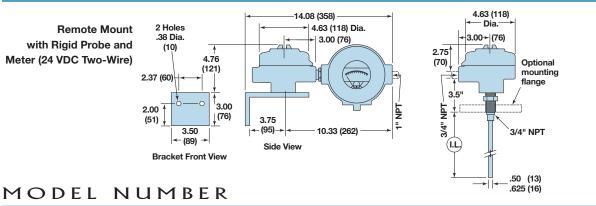


#### STANDARD PRESSURE

Models available for quick shipment, usually within one week after factory receipt of a complete purchase order, through the Expedite Ship Plan (ESP)

#### BASIC

0

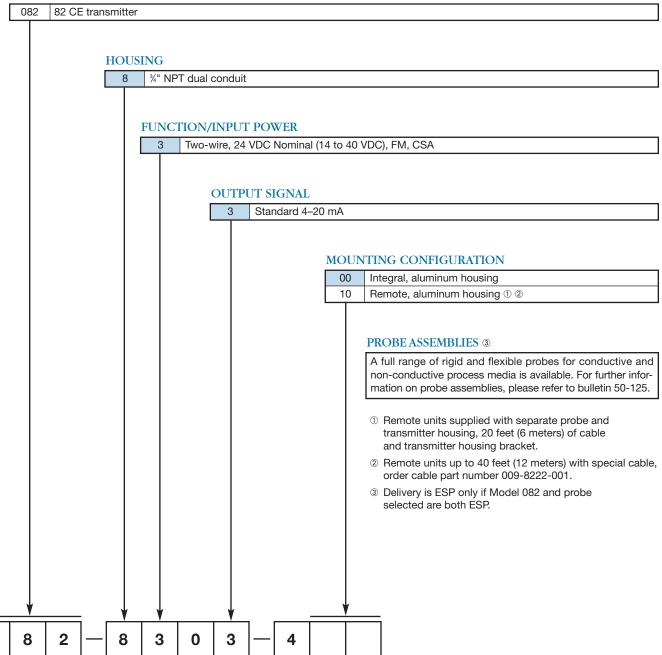

### AGENCY APPROVALS

AGENCY	APPROVED MODEL	PROTECTION METHOD	AREA CLASSIFICATION
FM	082-8303-400 082-8303-410	Intrinsically Safe	Class I, Div 1, Groups A, B, C & D; Class II, Div 1, Groups E, F & G; Class III, NEMA 4X
APPROVED		Non-Incendive	Class I, Div 2, Groups A, B, C & D
		Suitable for:	Class II, Div 2, Groups F & G; Class III
CSA	082-8303-400 082-8303-410	Intrinsically Safe ${\rm l}$	Class I, Div 1, Groups A, B, C & D; Class II, Div 1, Groups E, F & G; Class III, TYPE 4X
		Suitable for:	Class I, Div 2, Groups A, B, C & D; Class II, Div 2, Groups F & G; Class III
	082-8303-400 082-8303-410	Explosion Proof 2	Class I, Div 1, Groups C & D; Class II, Div 1, Groups E, F & G Class III <i>,</i> TYPE 4X

Not I.S. (CSA) for Groups E & F when used with a bare probe.

2 Approval is valid only with the use of insulated rigid probes.

# QUALITY



The quality assurance system in place at Magnetrol<sup>®</sup> guarantees the highest level of quality throughout the company. MAGNETROL is committed to providing full customer satisfaction both in quality products and quality service.

The MAGNETROL quality assurance system is registered to ISO 9001 affirming its commitment to known international quality standards providing the strongest assurance of product/service quality available.

#### ESP

Expedite Ship Plan Several Model 82 CE transmitter models are available for quick shipment, usually within one week after factory receipt of a purchase order, through the Expedite Ship Plan (ESP).

To take advantage of ESP, match the color coded model number codes in the selection charts (standard dimensions apply). ESP service may not apply to orders of ten units or more. Contact your local representative for lead times on larger volume orders, as well as other products and options.

# WARRANTY



All MAGNETROL electronic level and flow controls are warranted free of defects in materials or workmanship for eighteen months from the date of original factory shipment.

If returned within the warranty period; and, upon factory inspection of the control, the cause of the claim is determined to be covered under the warranty; then, MAGNETROL will repair or replace the control at no cost to the purchaser (or owner) other than transportation.

MAGNETROL shall not be liable for misapplication, labor claims, direct or consequential damage or expense arising from the installation or use of equipment. There are no other warranties expressed or implied, except special written warranties covering some MAGNETROL products.



705 Enterprise Street • Aurora, Illinois 60504-8149 • 630.969.4000 info@magnetrol.com • magnetrol.com

Copyright © 2019 Magnetrol International, Incorporated. Performance specifications are effective with date of issue and are subject to change without notice.

BULLETIN: 50-123.21 EFFECTIVE: May 2019 SUPERSEDES : February 2019